





## ACCESSIBLE URINALS

CBC §1115.4.2

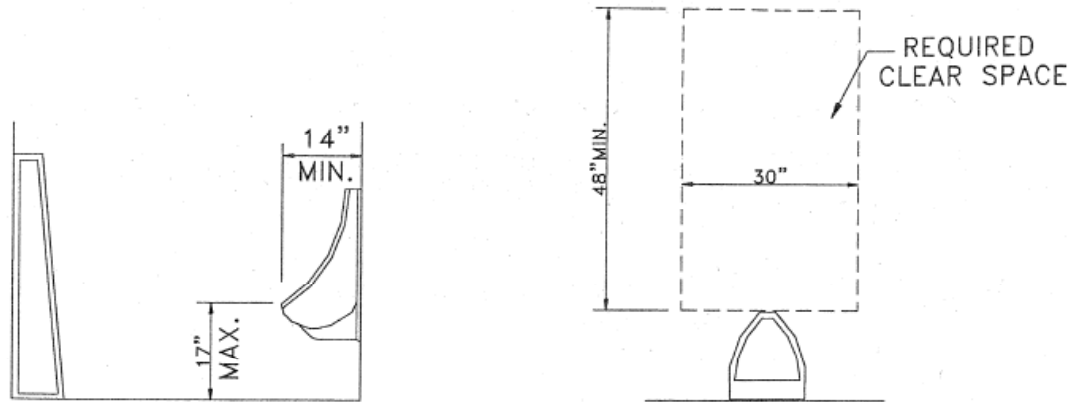

1. Urinals shall be floor mounted, stall-type or wall hung. Where one or more wall-hung urinals are provided, at least one with an elongated rim projecting a minimum of 14 inches from the wall and a maximum of 17 inches from the wall and a maximum of 17 inches above the floor shall be provided
2. Flush controls shall be operable with one hand and shall not require tight grasping, pinching or twisting of the wrist and shall be mounted no more than 44 inches above the floor. The force required to activate controls shall be no greater than 5 lbf. Electronic automatic flushing controls are acceptable and preferable
3. Where urinals are provided, at least one shall have a clear floor space 30 inches by 48 inches in front of the urinal to allow forward approach. The clear space shall comply with CBC 1118B.4.
4. One full unobstructed side of the clear floor or ground space for a wheelchair shall adjoin or overlap an accessible route or adjoin another wheelchair clear floor space. If a clear floor space is located in an alcove or otherwise confined on all or a part of three sides, additional maneuvering clearances shall be provided as shown. *CBC §1118B.4(2)*

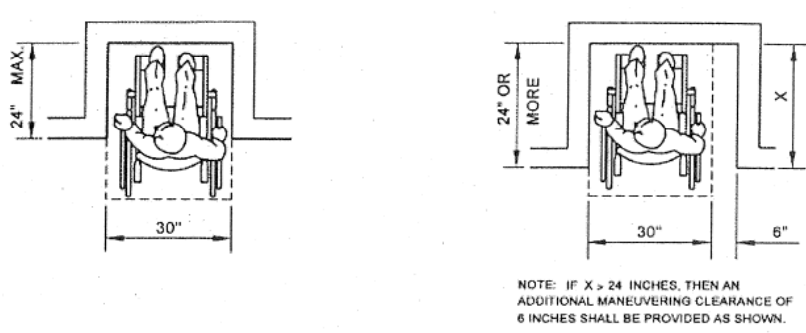

5. In other than dwelling units, toilet and bathing room floors shall have a smooth, hard, nonabsorbent surface that extends upward onto the walls at least 6 inches. *CBC §1210.1*
6. Walls within 2 feet of urinals and toilets shall have a smooth, hard, nonabsorbent surface, to a height of 4 feet above the floor, and except for structural elements, the materials used in such walls shall be of a type that is not adversely affected by moisture. *CBC §1210.2*